


STACKED MODELS MAP
MODELLLED CHARGEABILITY

Modified Pole-Dipole Array


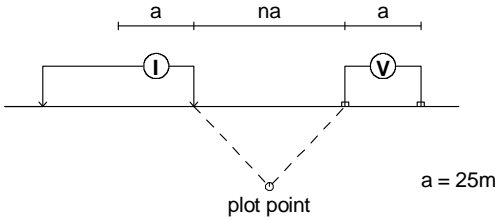


- L2400N Stationary electrode at West end of line.
- L2000N Stationary electrode at Station 1000W & 200E.
- L1600N Stationary electrode at West end of line.
- L1200N Stationary electrode at Stations 1000W & 225E.

Receiver: Iris ElrecPro

Transmitter: GDD Tx-II 3.6kW

Data File: all lines 25-final.gdb

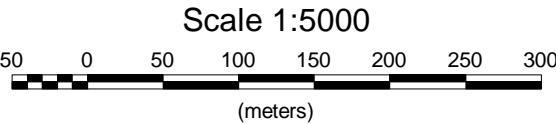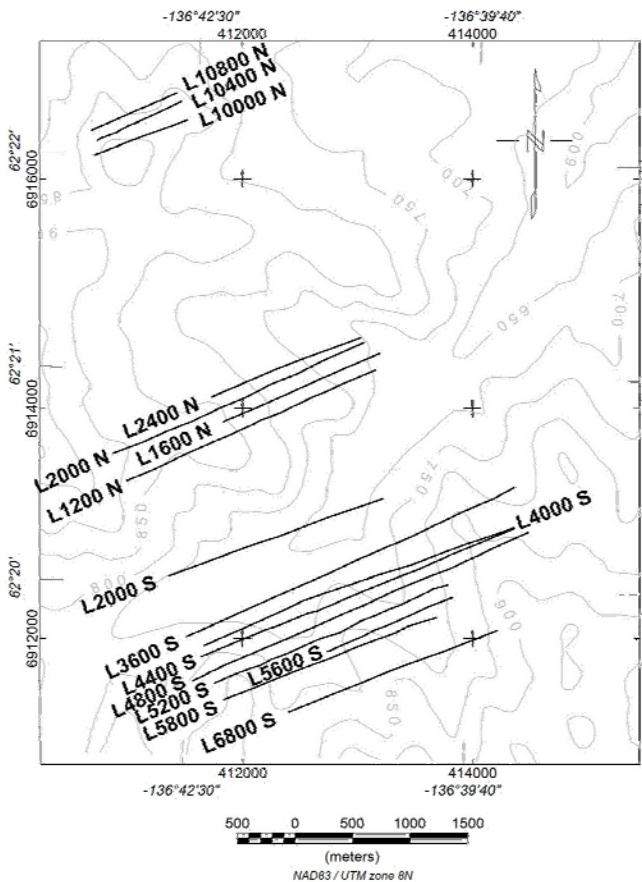

WESTERN COPPER CORPORATION

INDUCED POLARIZATION SURVEY
CARMACKS COPPER PROJECT
MODELLLED CHARGEABILITY - 25m DIPOLES
STACKED MODELS - NORTH LINES

Mining District: Whitehorse Datum: Local Grid
NTS: 115 I/07 Drawn by: HS
Job: WRN-7506-YT Date: 17 Jan 08

AURORA GEOSCIENCES LTD.