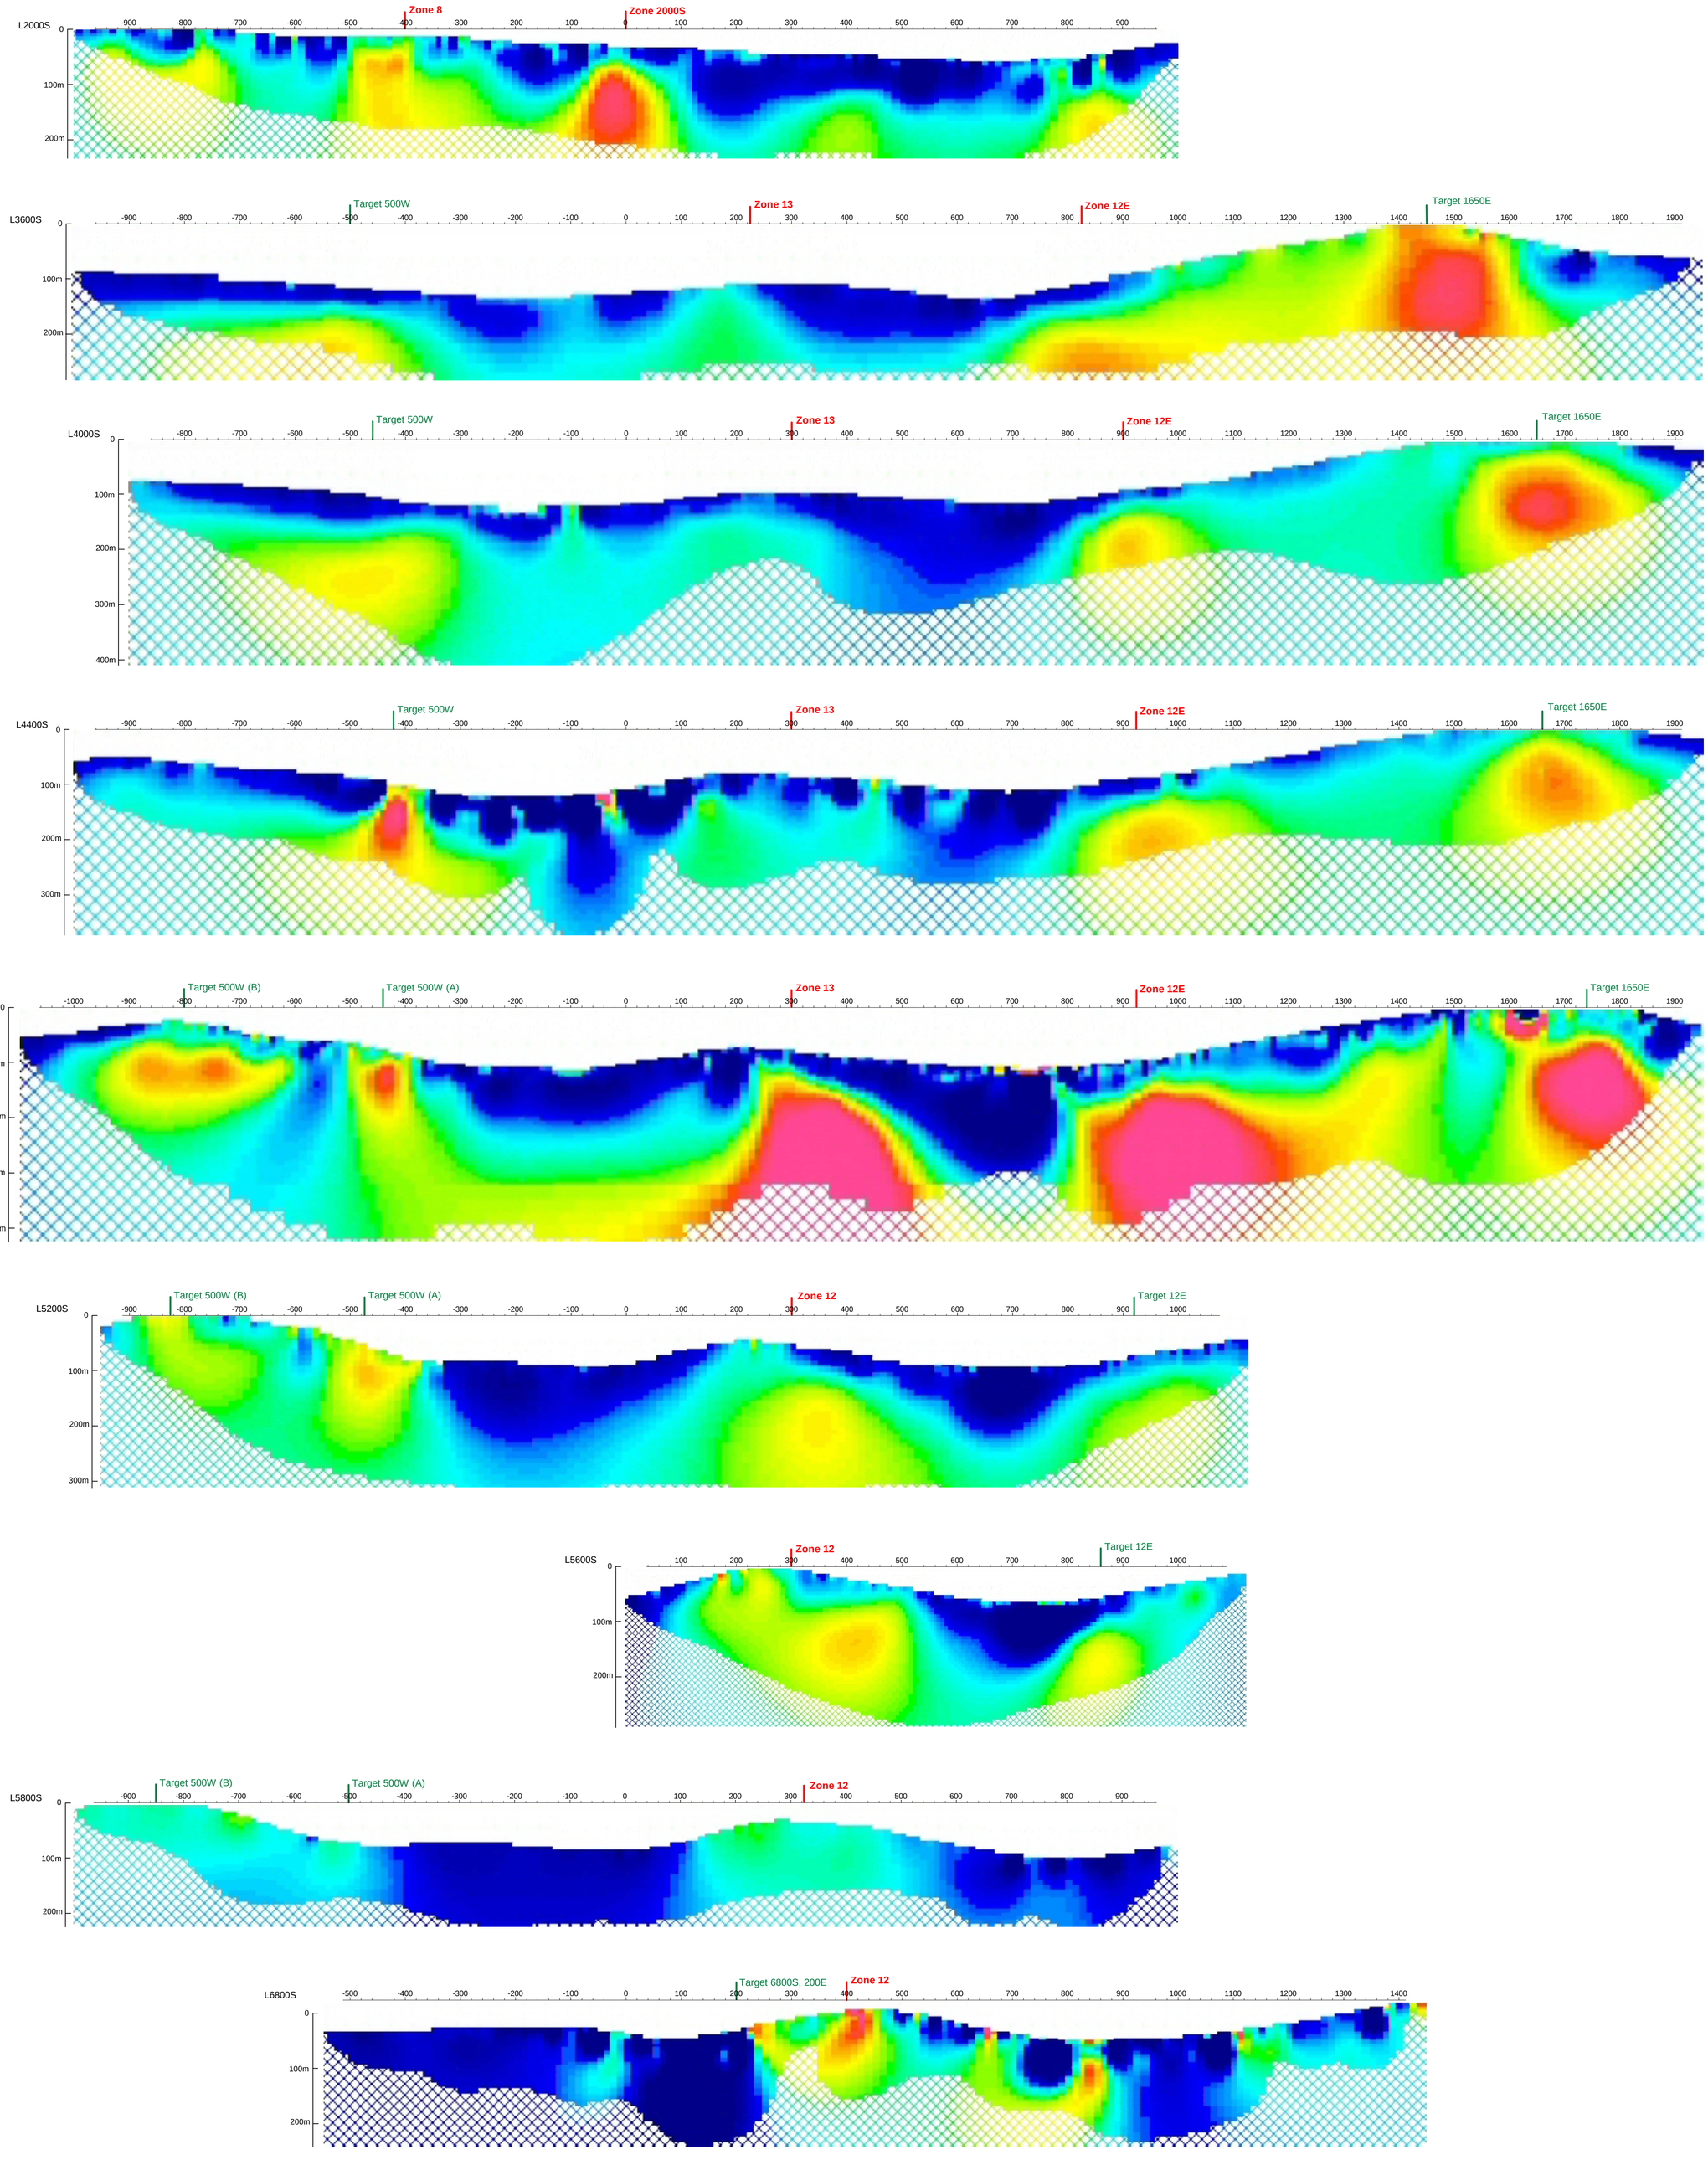

STACKED MODELS MAP

MODELLED CHARGEABILITY

Modified Pole-Dipole Array



L2000S Stationary electrode at West end of line.
L3600S Stationary electrode at Stations 1000W & 275E.
L4000S Stationary electrode at Stations 900W & 275E.
L4400S Stationary electrode at Stations 1000W & 650E.
L4800S Stationary electrode at West end of line.
L5200S Stationary electrode at West end of line.
L5600S Stationary electrode at West end of line.
L5800S Stationary electrode at West end of line.
L6800S Stationary electrode at West end of line.

Receiver: Iris ElrecPro

Transmitter: GDD Tx-II 3.6kW

Data File: all lines 25-final.gdb

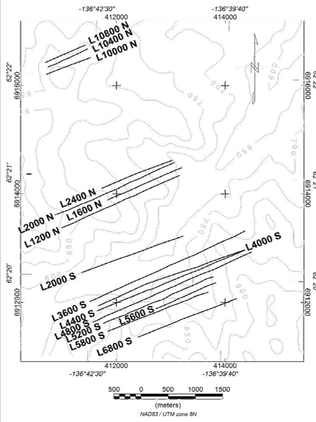

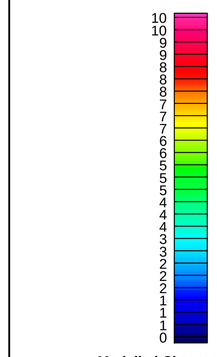

Modelled Chargeability

mV/V

Scale 1:5000

50 0 50 100 150 200 250 300

(meters)

WESTERN COPPER CORPORATION

INDUCED POLARIZATION SURVEY
CARMACKS COPPER PROJECT
MODELLED CHARGEABILITY - 25m DIPOLES
STACKED MODELS - SOUTH LINES

Mining District: Whitehorse
NTS: 115 I/07
Job: WRN-7506-YT

Datum: Local Grid
Drawn by: HS
Date: 16 Jan 08

AURORA GEOSCIENCES LTD.