


Modelled Chargeability
mV/V



STACKED MODELS MAP **MODELLED CHARGEABILITY**

Modified Pole-Dipole Array

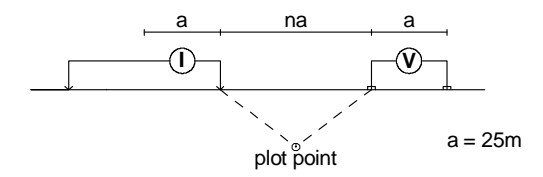

- L10800N Stationary electrode at West end of line.
- L10400N Stationary electrode at West end of line.
- L10000N Stationary electrode at West end of line.

Receiver: Iris ElrecPro
Transmitter: GDD Tx-II 3.6kW
Data File: all lines 25-final.gdb

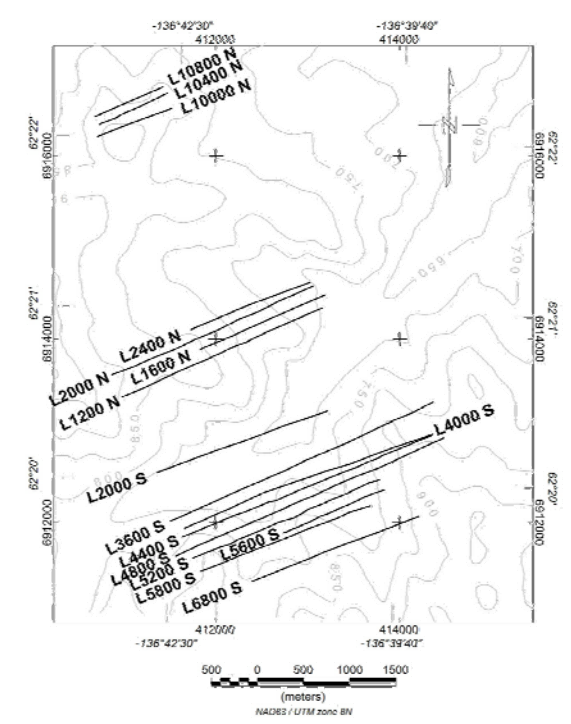

WESTERN COPPER CORPORATION
INDUCED POLARIZATION SURVEY
CARMACKS COPPER PROJECT
MODELLED CHARGEABILITY - 25m DIPOLES
STACKED SECTIONS - ZONE 2 LINES

Mining District: Whitehorse Datum: Local Grid
NTS: 115 I/07 Drawn by: HS
Job: WRN-7506-YT Date: 17 Jan 08

AURORA GEOSCIENCES LTD.