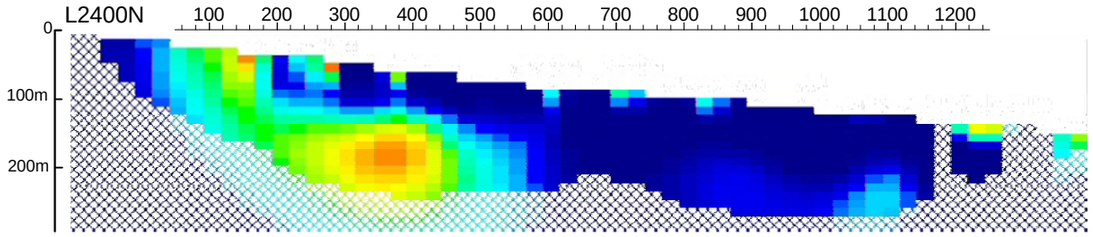

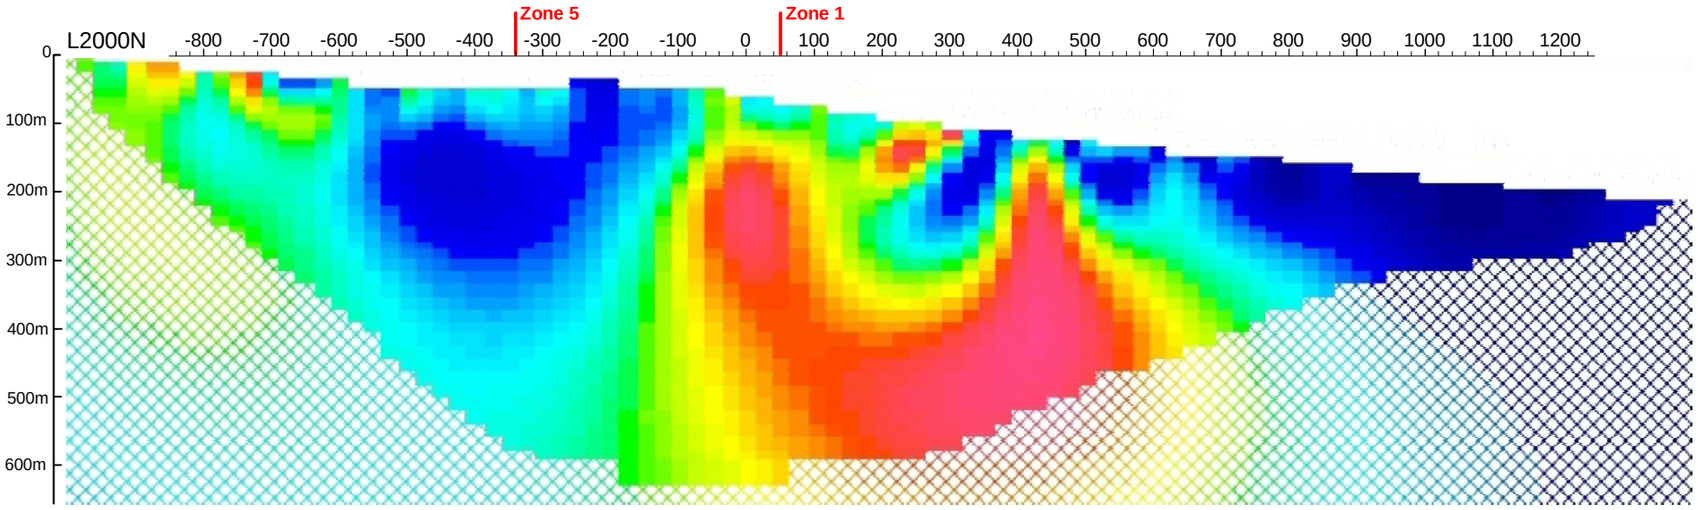

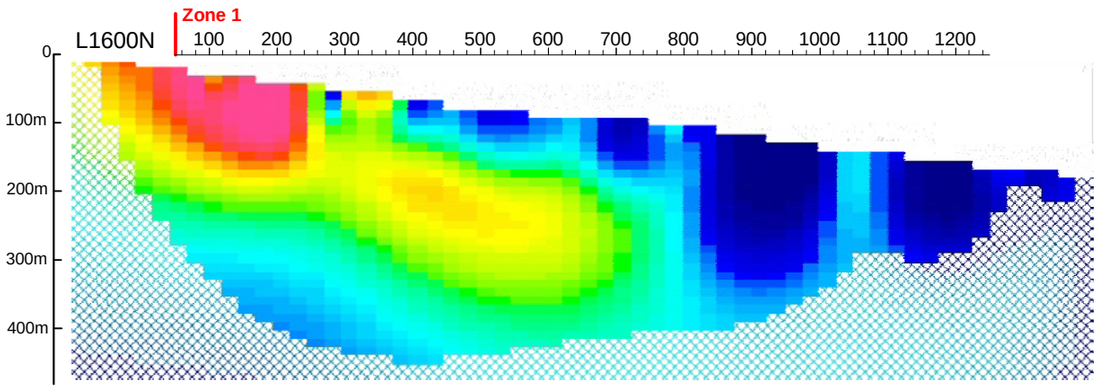

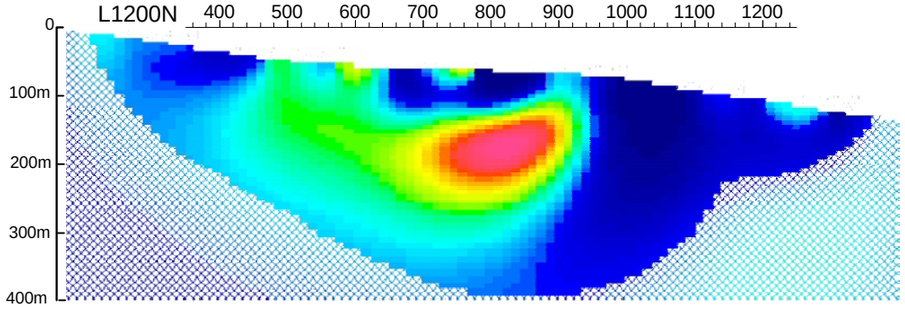

STACKED MODELS MAP

MODELLED CHARGEABILITY

Modified Pole-Dipole Array

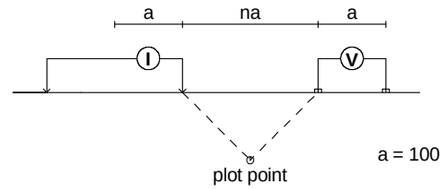

L1200N Stationary electrode at West end of line.
L1600N Stationary electrode at West end of line.
L2000N Stationary electrode at Stations 1000W & 200E
L2400N Stationary electrode at West end of line.

Receiver: Iris ElrecPro
Transmitter: GDD Tx-II 3.6kW
Data File: all lines 100m-final.gdb

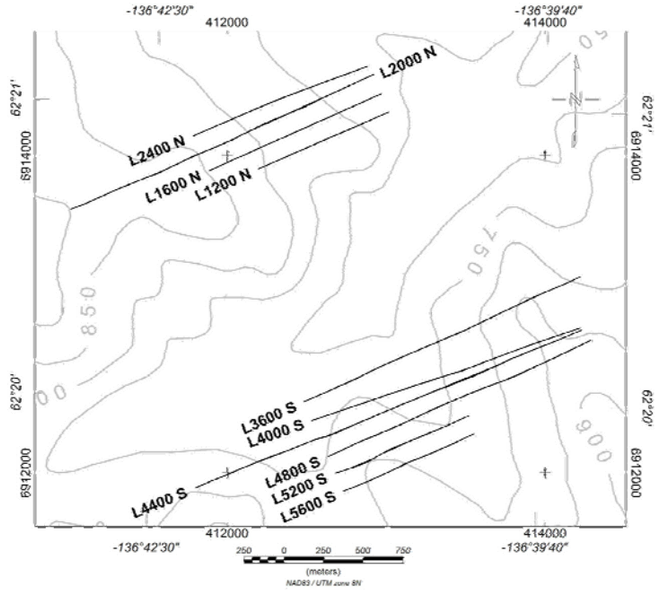



Modelled Chargeability

mV/V

Scale 1:10000

100 0 100 200 300 400 500 600

(meters)

WESTERN COPPER CORPORATION

INDUCED POLARIZATION SURVEY
CARMACKS COPPER PROJECT
MODELLED CHARGEABILITY - 100m DIPOLES
STACKED SECTIONS - NORTH LINES

Mining District: Whitehorse
NTS: 115 I/07
Job: WRN-7506-YT

Datum: Local Grid
Drawn by: HS
Date: 15 Jan 08

AURORA GEOSCIENCES LTD.